

ADDENDUM NO. 2
Waterfront Park Shoreline Improvements

To all prospective bidders and others concerned:

YOU ARE HEREBY ADVISED THAT the Contract Documents for the above referenced Project are revised in the following particulars:

Plan Sheet No.	Description of Change
Sheet E-1.0	Plan sheet E-1.0 has been updated in the plan set.


General/Clarifications

This Addendum is hereby incorporated into the original Contract Documents for the bidding referred to above and is considered as binding as though originally appearing therein. The Bidder will be required to acknowledge the receipt of this Addendum on QuestCDN in order to submit a valid Bid. Any Bids that were submitted prior to issuance of this Addendum will not be valid until receipt of this Addendum is acknowledged on QuestCDN.

PROJECT MANAGER: FIELD BOOK INFORMATION: DATE PLOTTED: 4/23/2024 3:30 PM BY: DENNIS, KATE



Know what's below.
Call before you dig.

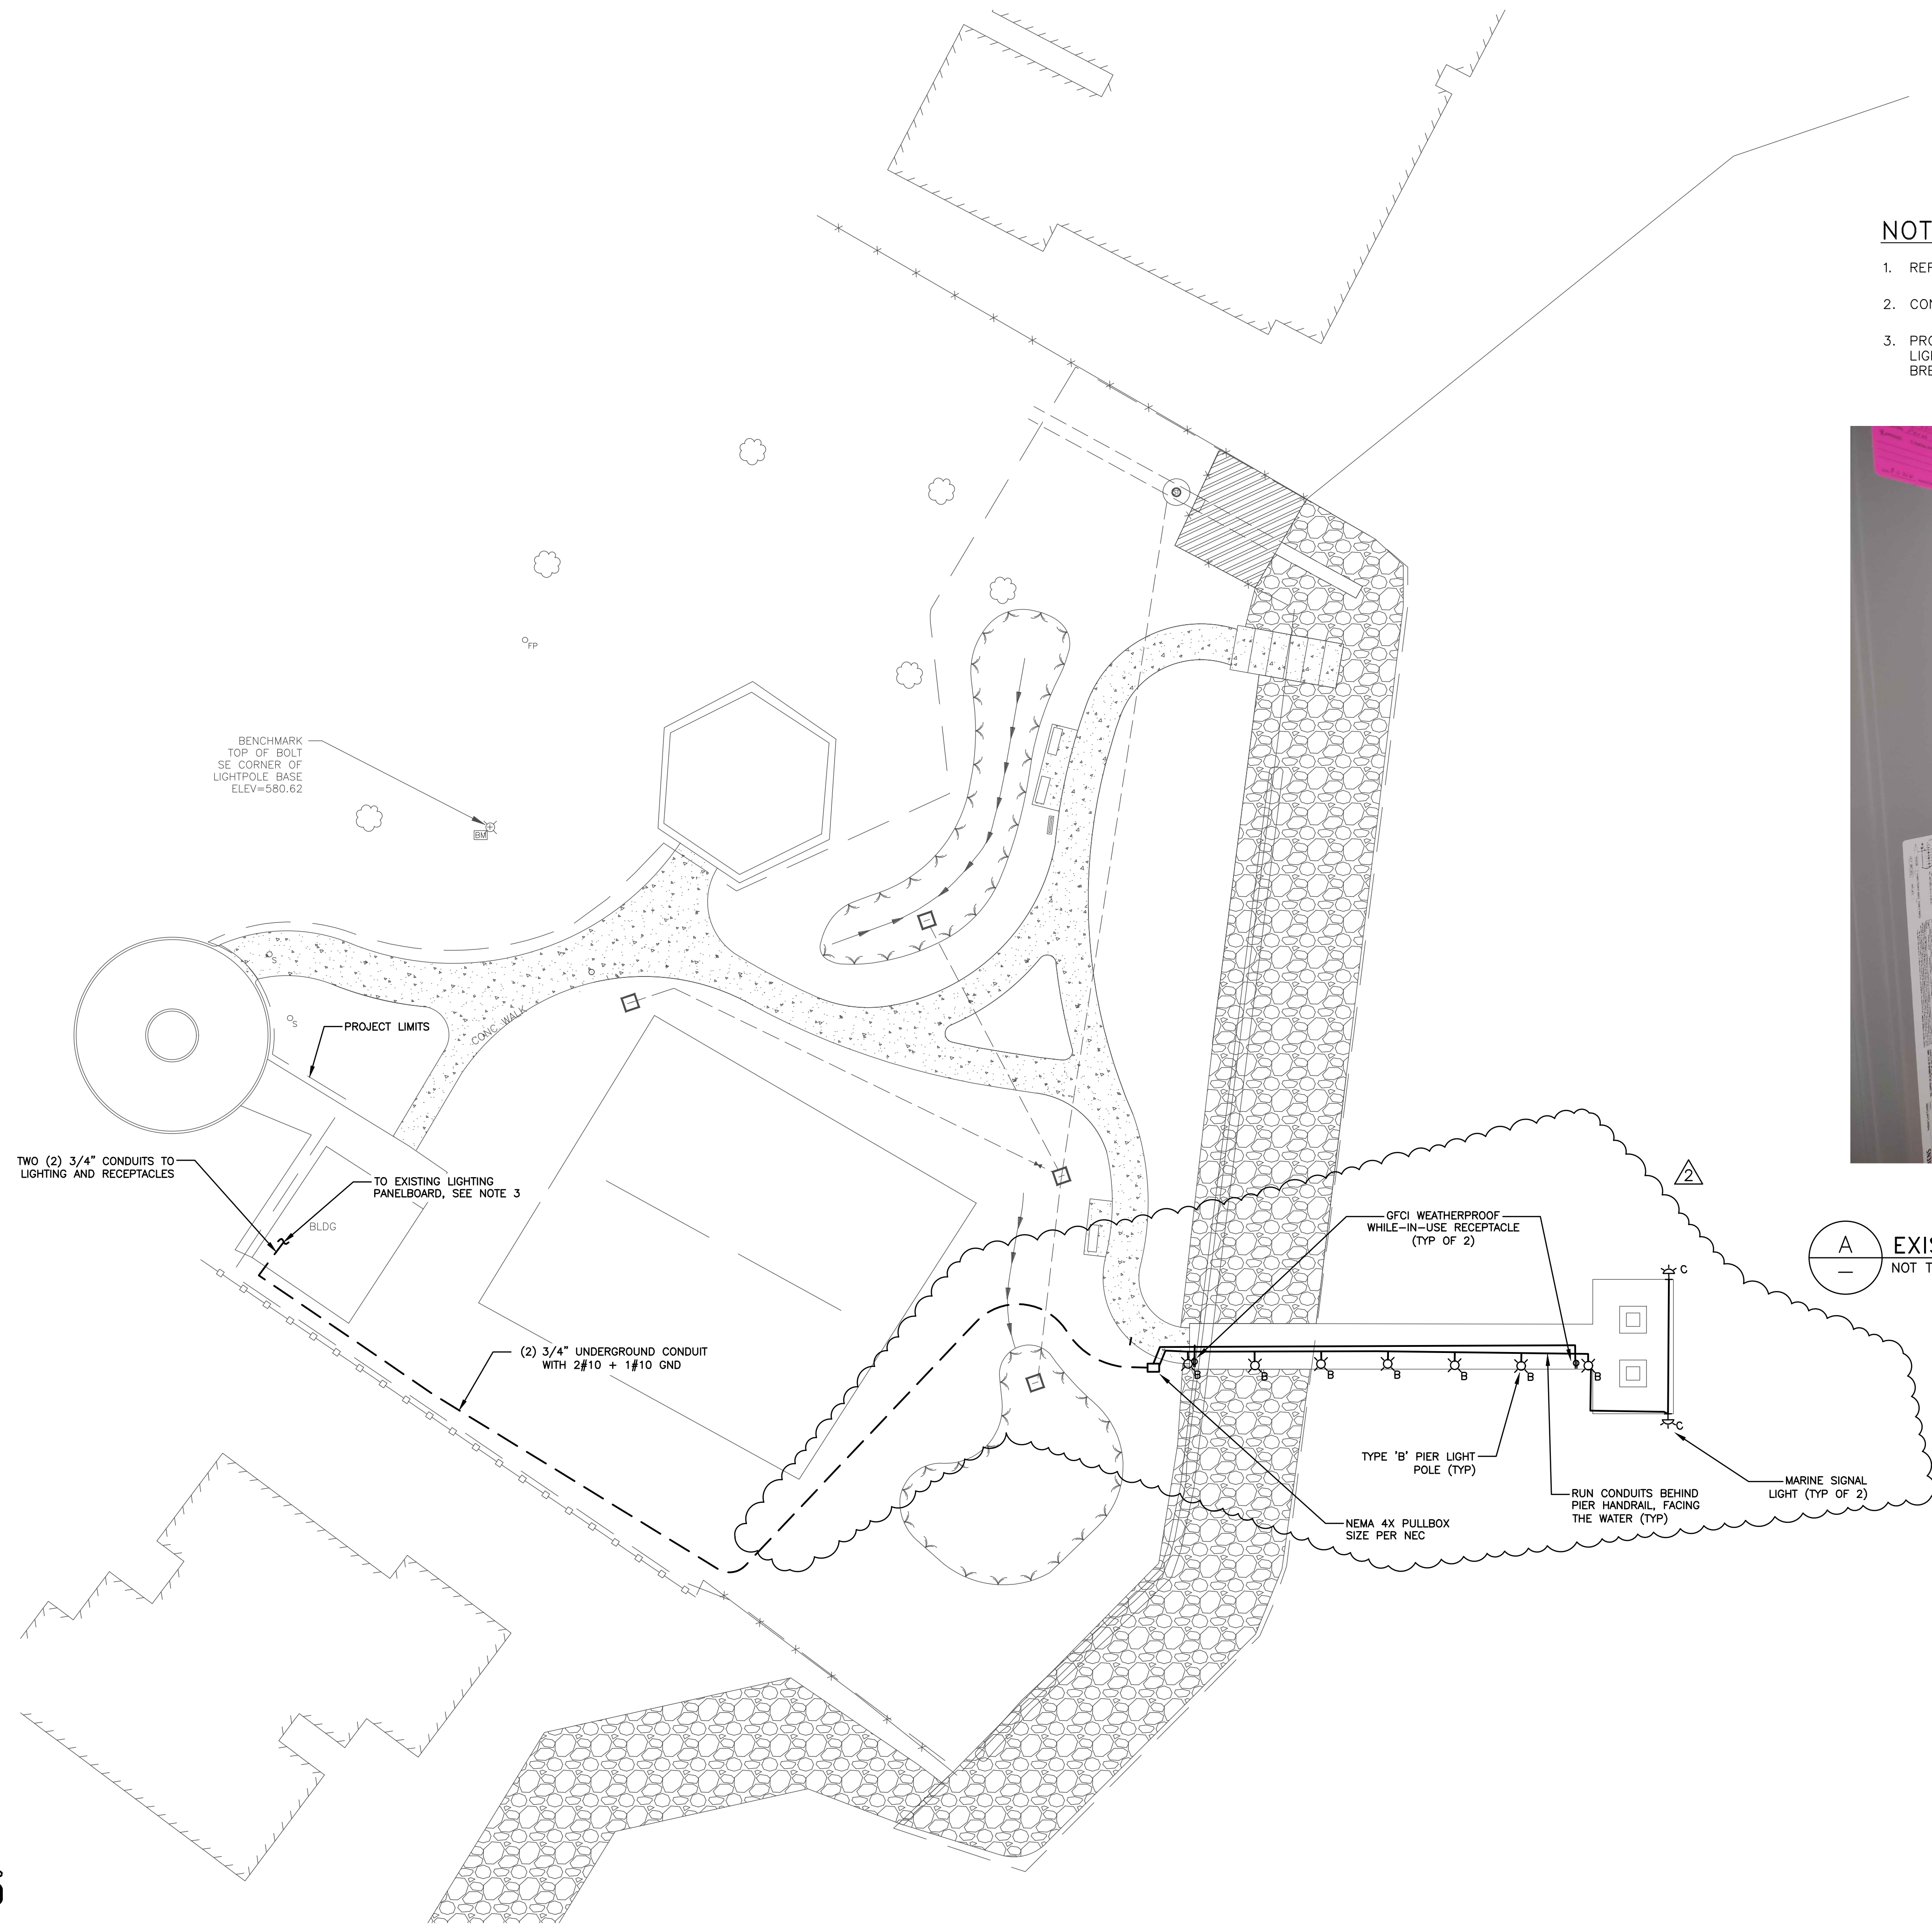


NOTES:

1. REFER TO SHEET E-1.1 FOR LIGHTING DETAILS.
2. CONTRACTOR MUST COORDINATE WITH EXISTING UTILITIES FOR ANY FIELD CONFLICTS.
3. PROVIDE (2) 20A CIRCUIT BREAKERS, 120V, 1 PHASE. ONE CIRCUIT BREAKER TO POWER THE LIGHTING AND THE SECOND ONE TO POWER THE OUTDOOR RECEPTACLES. PROVIDE CIRCUIT BREAKERS MATCHING EXISTING PANELBOARD RATINGS. SEE PHOTO ON THIS SHEET.



FURNISH NEW 20A CIRCUIT BREAKER. SEE NOTE 3

A EXISTING PANELBOARD MODIFICATIONS
NOT TO SCALE



REV#	DATE	DESCRIPTION	BY

500 Griswold Avenue, Suite 2500
 Detroit, MI 48226
 313.961.3600
 www.wadetrिम.com

WADE TRIM

**HARRISON TOWNSHIP
 WATERFRONT PARK
 SHORELINE IMPROVEMENTS**
 ELECTRICAL SITE PLAN

ISSUED FOR: ADD 2	DATE: 4/10/24 MDC 4/29/24 MDC	BY: MDC
JOB NO. HSN6004.03D		
SHEET E-1.0		

© Wade Trim Group, Inc. WATERFRONT PARK